

BERRIDGE SPACEFRAME BUILDING COMPONENTS DESIGN GUIDE

CONTENTS

PROPERTIES & LOADS

24 Ga. Stud Properties & Loads	2
Back to Back Stud Properties & Loads	2
C-Channel Rafter Properties & Loads.....	3
Load Transfer Member Properties & Loads.....	3

TYPICAL INSTALLATION DETAILS

BSC-10 Wall Section.....	4
BSC-11 Framing Detail.....	5
BSC-12 Ridge/Knee Wall	6
BSC-13 Wall Corner Details	7
BSC-14 Elevation.....	8



Berridge Manufacturing Company
6515 Fratt Rd, San Antonio, TX 78218
210-650-3050 | 800-669-0009
www.berridge.com



SINGLE 24 GA STUD

MEMBER	PHYSICAL PROPERTIES					GROSS PROPERTIES						
	THICKNESS (in)	DEPTH (in)	FLANGE (in)	LIP (in)	WEIGHT (lb/ft)	Ag (in ²)	Ix (in ⁴)	Sx (in ³)	Iy (in ⁴)	Sy (in ³)	rx (in)	ry (in)
SINGLE STUD	0.024	3.5	1.450	---	0.535	0.157	0.252	0.155	0.043	0.039	1.265	0.526

MEMBER	TORSIONAL PROPERTIES			FULL BRACED PROPERTIES & ALLOWABLE STRENGTH					
	J (in ⁴)	Cw (in ⁶)	Xo (in)	Ae (in ²)	Ix (in ⁴)	Sx (in ³)	TENSION (lbs)	MOMENT (lbs-ft)	SHEAR (lbs)
SINGLE STUD	0.00003023	0.0715	-1.045	0.105	0.252	0.155	3771	309	1171



DOUBLE 24 GA. STUD

MEMBER	PHYSICAL PROPERTIES					GROSS PROPERTIES						
	THICKNESS (in)	DEPTH (in)	FLANGE (in)	LIP (in)	WEIGHT (lb/ft)	Ag (in ²)	Ix (in ⁴)	Sx (in ³)	Iy (in ⁴)	Sy (in ³)	rx (in)	ry (in)
DOUBLE STUD	0.024	3.5	1.450	---	1.07	0.31491	0.504	0.309	0.149	0.097	1.265	0.689

MEMBER	TORSIONAL PROPERTIES			FULL BRACED PROPERTIES & ALLOWABLE STRENGTH					
	J (in ⁴)	Cw (in ⁶)	Xo (in)	Ae (in ²)	Ix (in ⁴)	Sx (in ³)	TENSION (lbs)	MOMENT (lbs-ft)	SHEAR (lbs)
DOUBLE STUD	0.00006046	0.14307	0.00	0.21001	0.504	0.309	7542	618	2343

NOTES:

1. STRUCTURAL PROPERTIES HAVE BEEN COMPUTED IN ACCORDANCE WITH THE 2001 NORTH AMERICAN SPECIFICATION (US-ASD).
2. THICKNESS SHOWN IS DESIGN THICKNESS WITHOUT COATING.
3. STEEL IS ASTM 653 GRADE 40 FY=40 KSI, FU=55 KSI.

**24 GA. STUD
MAXIMUM ALLOWABLE AXIAL LOADS (LBS)
LATERAL WIND PRESSURE**

WALL HEIGHT	STUD SPACING	0 (PSF)	10 (PSF)			15 (PSF)			20 (PSF)			25 (PSF)		
			L/240	L/360	L/600	L/240	L/360	L/600	L/240	L/360	L/600	L/240	L/360	L/600
8'	16"	1700	1150	1150	1150	900	900	---	725	725	---	500	--	---
9'	16"	1570	900	900	---	650	650	---	450	---	---	--	---	---
10'	16"	1440	725	725	---	450	---	---	---	---	---	---	---	---

NOTES:

1. THE EXTERIOR WALLS SHALL HAVE PLYWOOD ON THE EXTERIOR SIDE OF THE WALL ALONG WITH THE GYPBOARD ON THE INTERIOR SIDE OF THE WALL. THE PLYWOOD AND GYPBOARD SHALL BRACE THE STUD CONTINUOUSLY. DESIGN ASSUMPTIONS ARE Lx=WALL HEIGHT, Ly & Lt=1'.
2. THE STUD SHALL HAVE FULL END BEARING AT THE TOP AND BOTTOM TRACKS.
3. --- INDICATES THAT THE CAPACITY OF THE STUD HAS BEEN EXCEEDED.
4. N.A. = NOT APPLICABLE.



**LOAD TRANSFER MEMBER
LOAD TABLES**

LENGTH (FT)	ALLOWABLE AXIAL LOADS (LBS)
3	1250
4	950
5	700
6	550
7	300

NOTES:

1. DESIGN ASSUMPTIONS ARE $L_x=L_y=L_t$ =FULL LENGTH OF MEMBER.
3. STEEL IS ASTM A-653 GRADE 50 $FY=40$ KSI, $FU=50$ KSI.



**ROOF RAFTER (DOUBLE 24 GA. STUD SECTION)
LOAD TABLES**

SPAN (FT)	MAX. ALLOWABLE UNIFORM ROOF PRESSURE AT 16" O.C. (PSF)
5	128
6	84
7	60
8	42
9	36
10	24

NOTES:

1. EITHER PLYWOOD IS ATTACHED DIRECTLY TO THE TOP OF THE RAFTERS OR METAL DECK IS ATTACHED TO THE TOP (OUTSIDE) FLANGE OF THE ROOF RAFTER (DOUBLE STUD) SECTION. DESIGN ASSUMPTIONS ARE $L_x=L_t$ =SPAN LENGTH & $L_y=4'$.
2. ALL SPANS ARE FOR DOUBLE SECTION RAFTER MEMBER IN BACK-TO-BACK ORIENTATION. DOUBLE SECTIONS SHALL BE CONNECTED WITH (2) #12 SDS SPACED AT 1"-1 1/2" - 1" VERTICALLY AND 24" O.C. LENGTHWISE.
3. MAXIMUM UNIFORM LOADS ARE THE TOTAL LOADS ON THE LOAD ON THE MEMBER INCLUDING SELF-WEIGHT.
4. ROOF RAFTER SHALL BE LOCATED DIRECTLY ABOVE WALL STUD.



**16 GA CEE CHANNEL CEILING JOIST
LOAD TABLE**

SPAN (FT)	MAX. ALLOWABLE UNIFORM ROOF PRESSURE AT 16" O.C. (PSF)
5	960
6	666
7	490
8	374
9	330
10	235
11	190
12	158
13	133
14	114
15	98
16	85
17	75
18	66
19	58
20	52

NOTES:

1. GYPBOARD IS ATTACHED TO THE BOTTOM FLANGE OF THE CEILING JOISTS.
2. STEEL IS ASTM A 653 GRADE 50 $FY=50$ KSI, $FU=65$ KSI.
3. MAXIMUM UNIFORM LOADS ARE THE TOTAL LOADS ON THE LOAD ON THE MEMBER INCLUDING SELF-WEIGHT.
4. CEILING JOIST SHALL BE LOCATED DIRECTLY ABOVE WALL STUDS AT EACH END.

(2) BACK TO BACK,
1 1/2" x 3 1/2" 24ga
STUDS 16" o.c.

1 1/2" x 3 1/2" 24ga
BLOCKING CONTINUOUS
ALONG STUDS

#8 x 9/16"
HEX HEAD
POINTED

**BSC-11
EAVE**

FASCIA &
SOFFIT

CONTINUOUS
8" x 2" 16ga TRACK

CONTINUOUS 24ga
EDGE TRIM

#8 x 9/16" HEX
HEAD POINTED

#8 x 9/16" HEX HEAD
SELF-DRILLING

8" x 2 1/2" 16ga or 14ga
CEE CHANNEL 16" o.c.

#8 x 9/16" WAFER
HEAD POINTED

CONTINUOUS
1 9/16" x 3 9/16"
24ga TRACK

10'-0" x 1 1/2" x 3 1/2"
24ga STUD 16" o.c.

#8 x 9/16" WAFER
HEAD POINTED

**BSC-11
BLOCKING**

1 1/2" x 3 1/2" 24ga
BLOCKING
CONTINUOUS
BETWEEN STUDS AT
MID SPAN OF WALL

10'-0" x 1 1/2" x 3 1/2"
24ga STUD 16" o.c.

10'-0" x 1 1/2" x 3 1/2"
24ga STUD 16" o.c.

CONTINUOUS
1 9/16" x 3 9/16"
24ga TRACK
ATTACH TO
SLAB PER
LOCAL CODES

#8 x 9/16" WAFER
HEAD POINTED

GRADE



Berridge
Manufacturing
Company



WALL SECTION

BUILDING SYSTEM
COMPONENTS

DATE: 1-10-07

PAGE\FILE

BSC-10

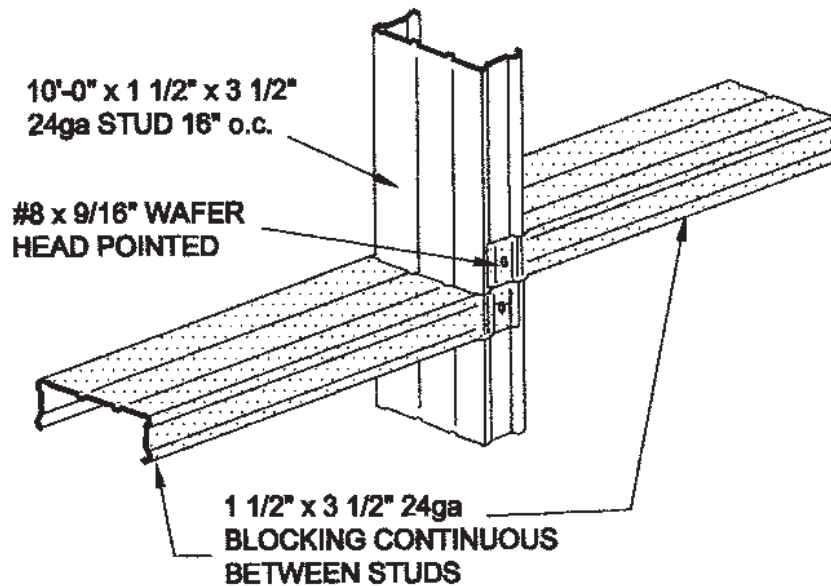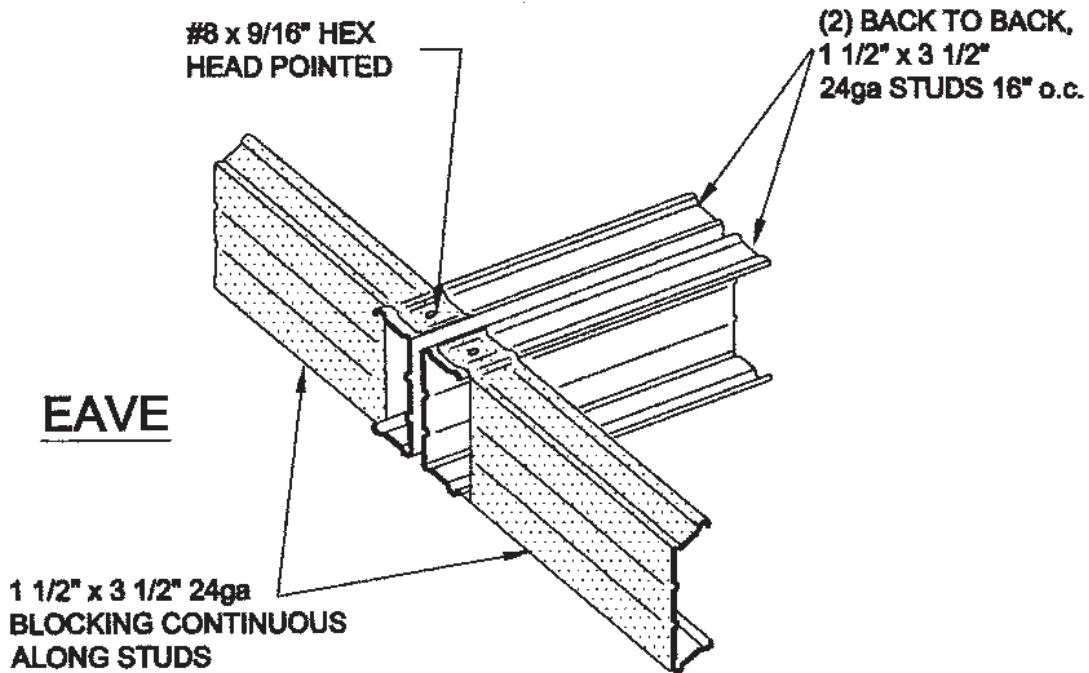

BLOCKING - WALL SPACING UNDER 60"
 - ROOF SPACING 24" O.C.



Berridge
 Manufacturing
 Company


Roofs of Distinction

FRAMING DETAIL

BUILDING SYSTEM
 COMPONENTS

DATE: 1-10-07

PAGE\FILE
BSC-11

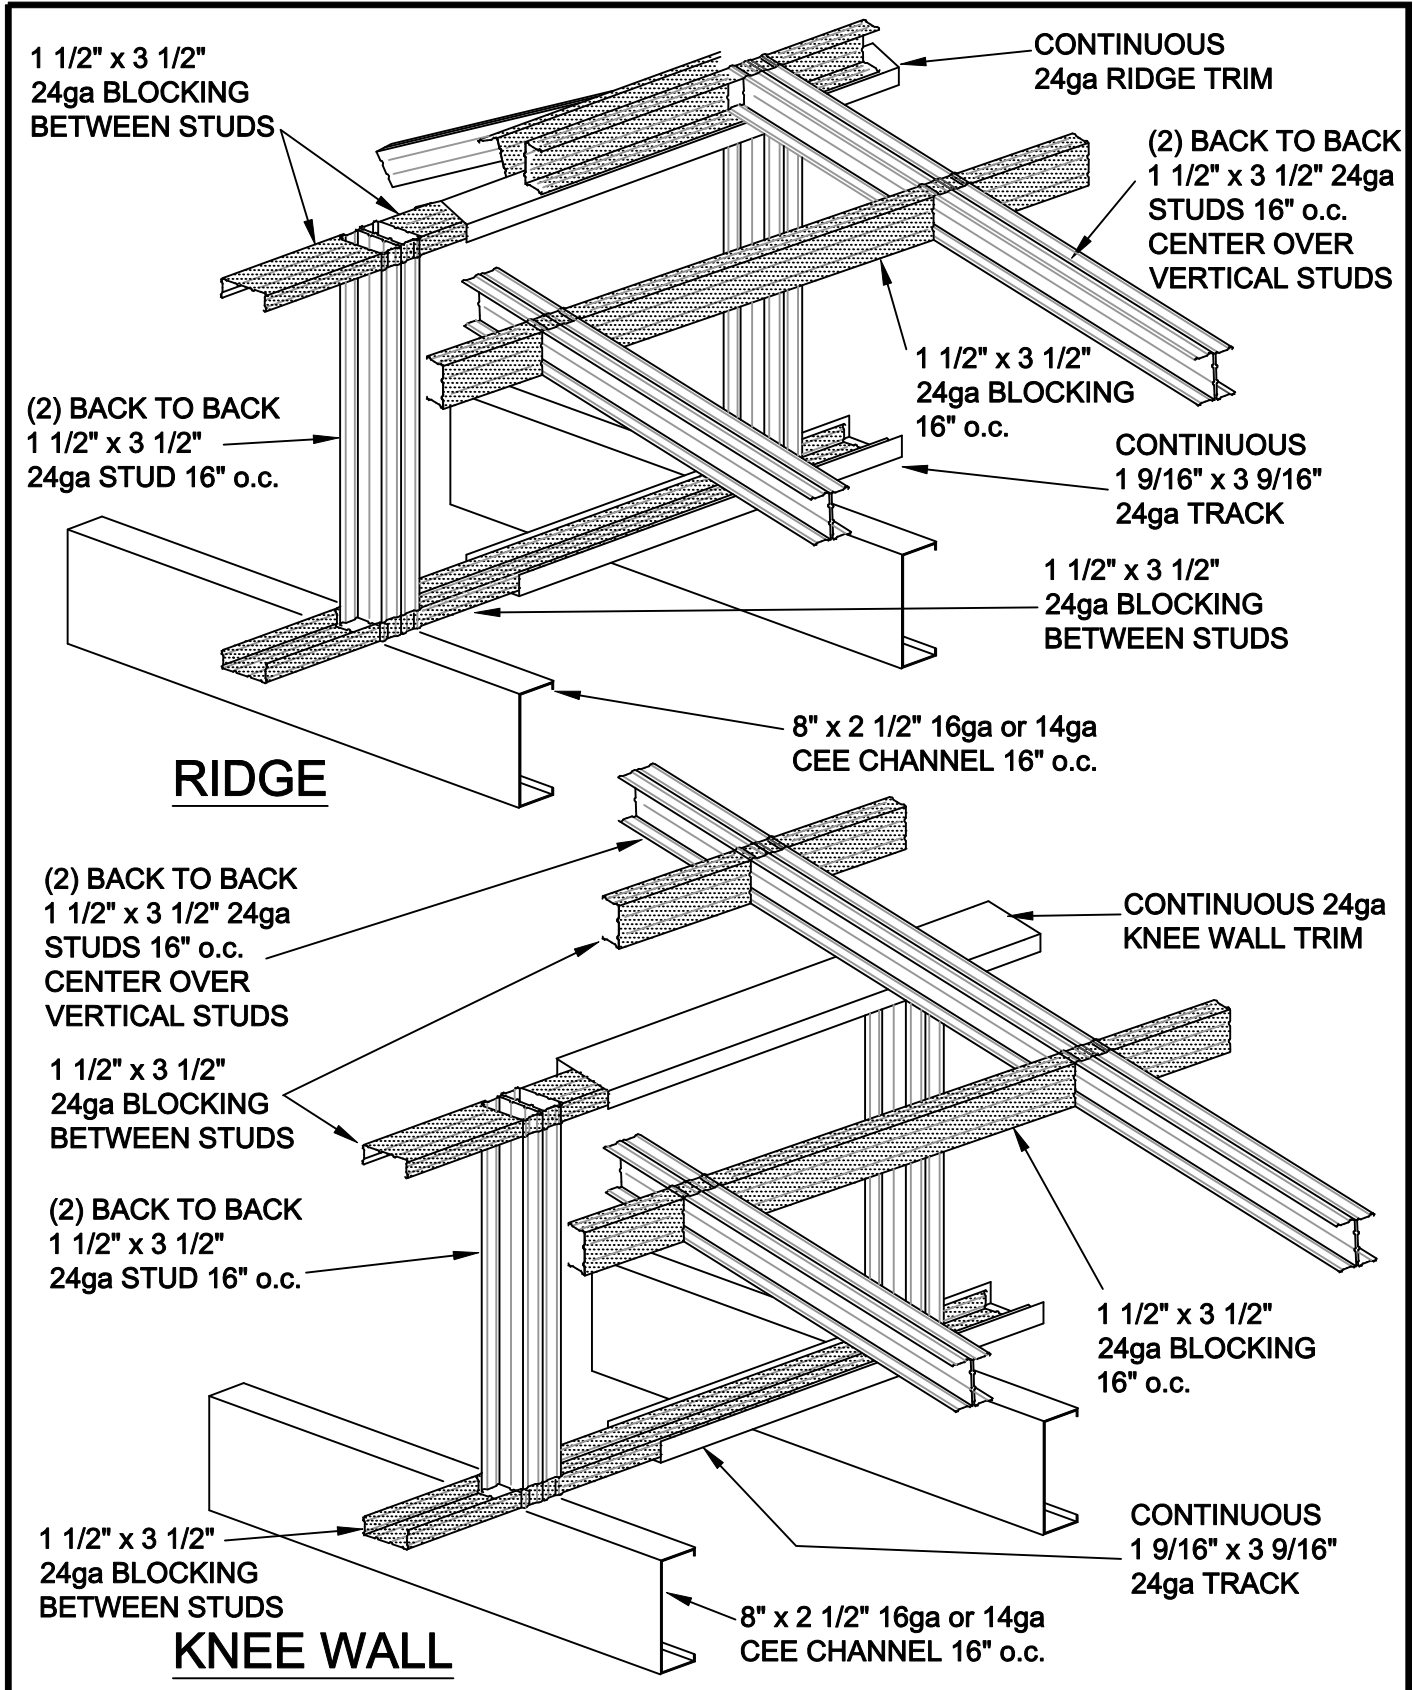


**Berridge
Manufacturing
Company**

RIDGE/KNEE WALL


**BUILDING SYSTEM
COMPONENTS**

DATE: 1-10-07

PAGE\FILE
BSC-12

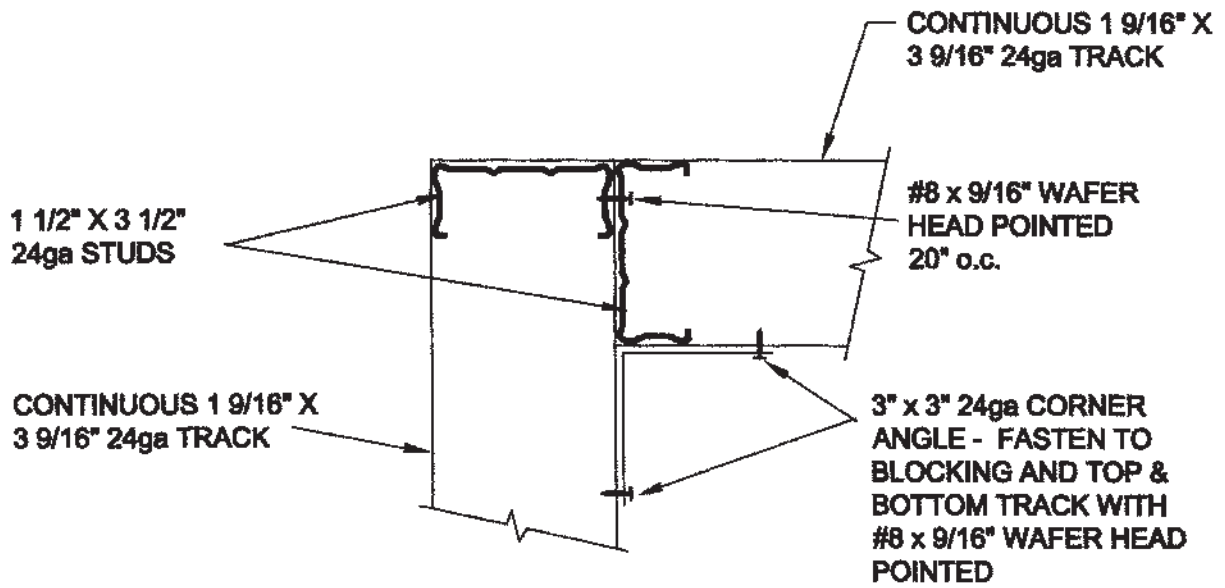

**INSIDE / OUTSIDE
CORNER**

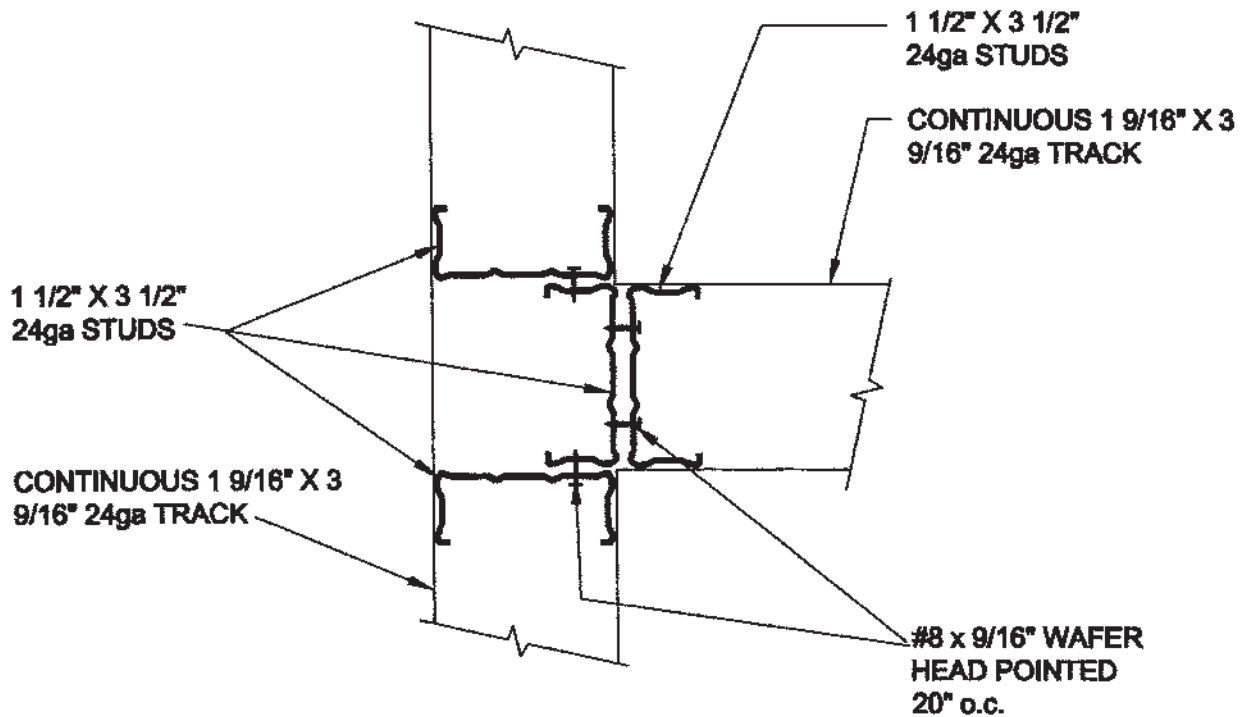

T - CORNER




**Berridge
Manufacturing
Company**



**WALL
CORNER DETAILS
BUILDING SYSTEM
COMPONENTS**

DATE: 1-10-07


PAGE\FILE
BSC-13

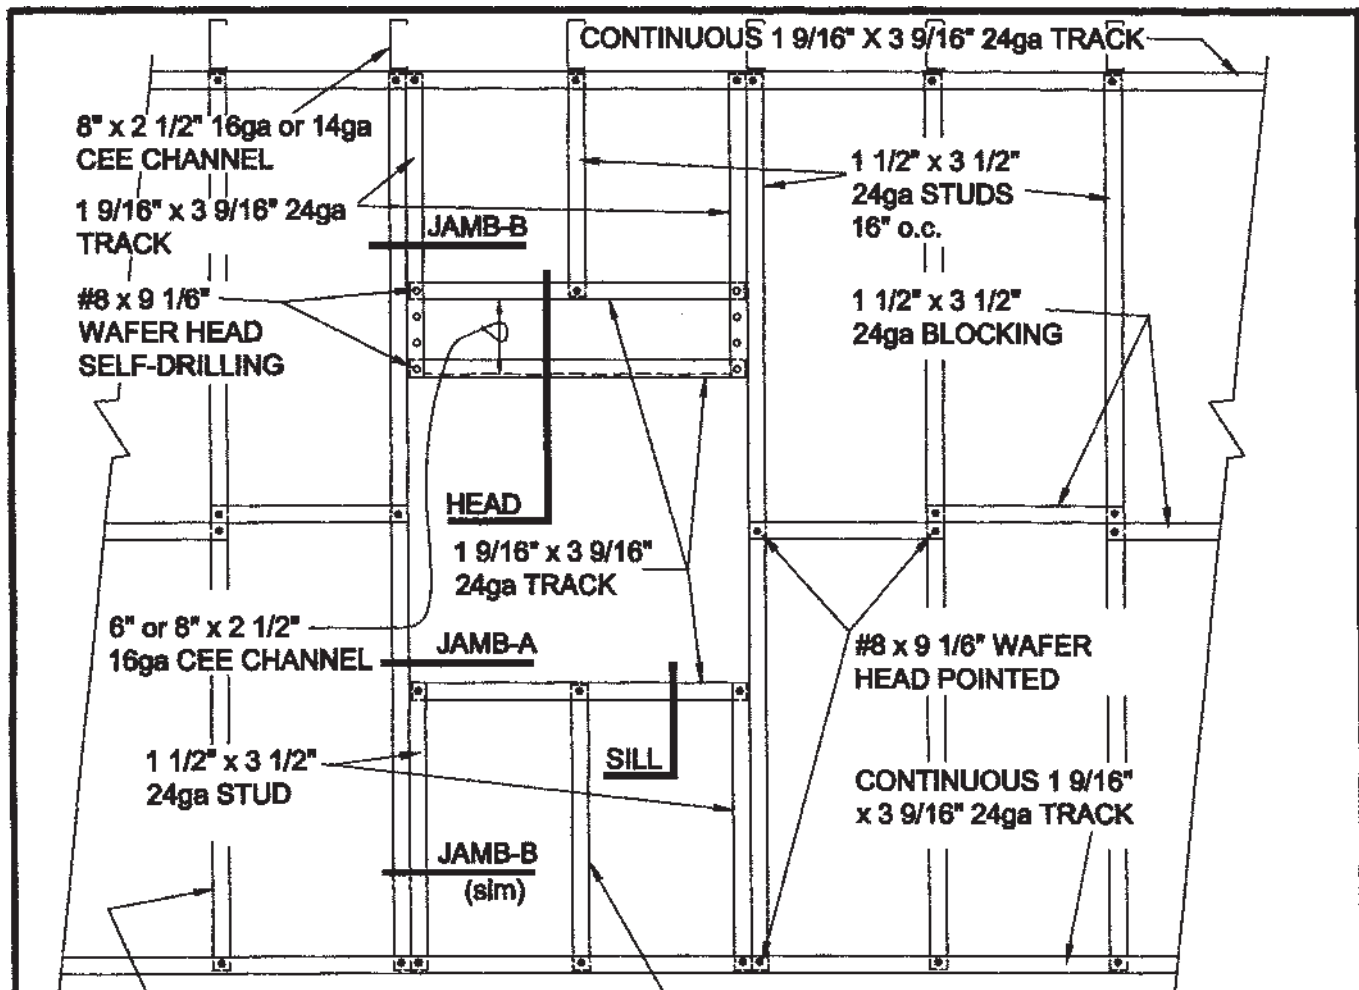

ELEVATION

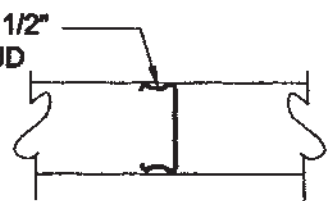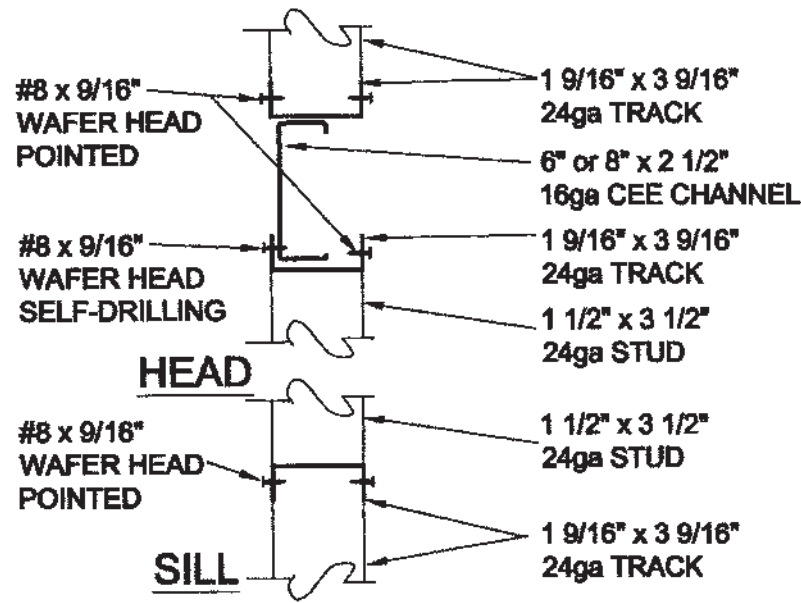

JAMB - A

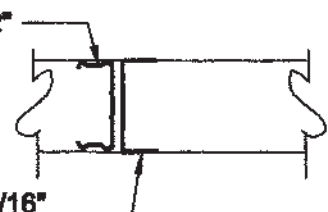

JAMB - B

B Berridge Manufacturing Company
Roofs of Distinction

ELEVATION
BUILDING SYSTEM COMPONENTS

DATE: 1-10-07
 PAGE\FILE
BSC-14